


Savage B Series Precision Targets

5 August 2026 @ Styx River

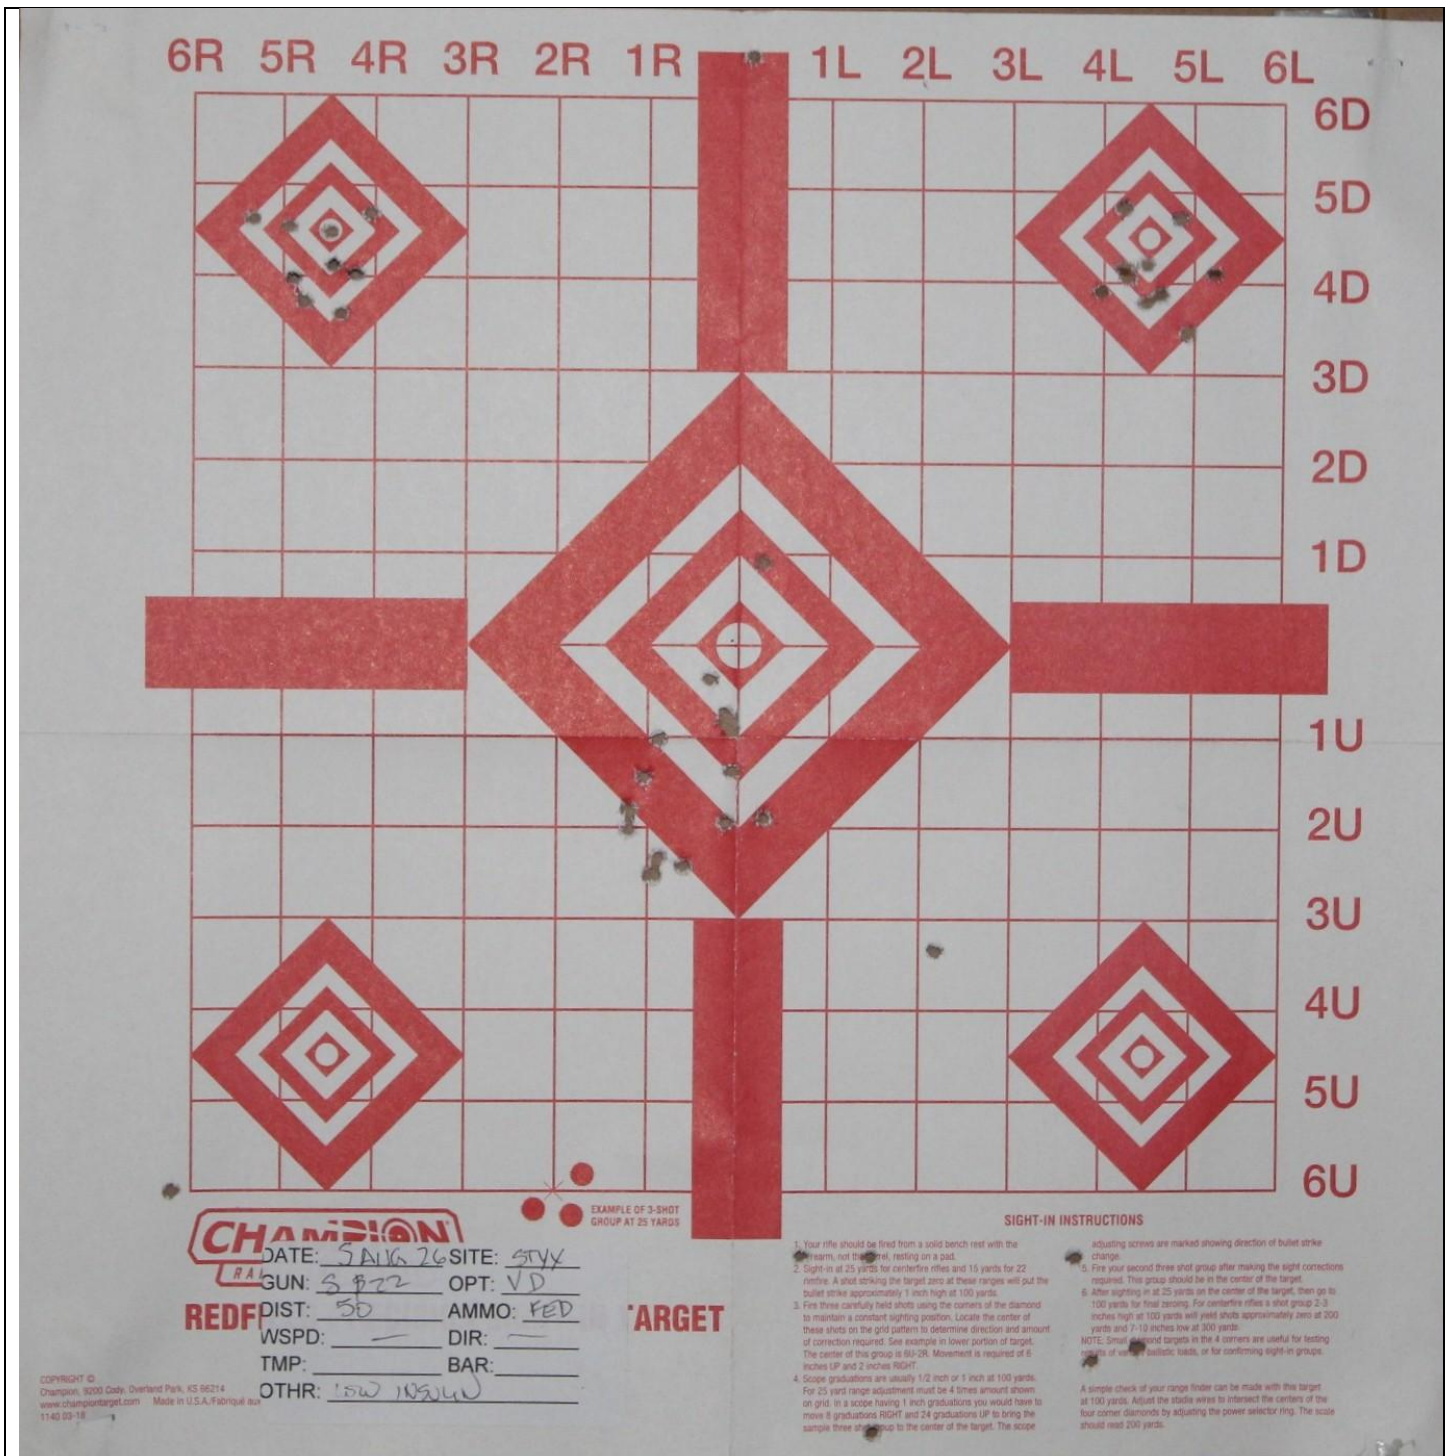

50 yards initially sighting-in, scatter low and right
then holding to check grouping.

Note groups at top after “final adjustments”

Note single round at top of vertical bar—targeted top & dead center of bar.



50 yards, 10 rounds @ "rapid fire"
Seeking to determine how well I could rapidly track to next target
Heat index >95



First attempt to sight @100 yards—abject/dismal failure
 Low blood glucose alarm had been sounding, but phone was not close to me (didn't hear it)
 Blood glucose was low @ <80
 Began experiencing extractor issues—rounds remained in chamber.
 Heat index 100
 Returned later and shot top left, then center after blood glucose stabilized

25 YD. SLOW-FIRE PISTOL TARGET
(STANDARD AMERICAN TYPE)

Match No: _____
Competitor: _____

Shots touching a scoring ring
receive the higher value.
Shots outside of scoring ring
are recorded as misses.




DATE: 5 AUG 22 SITE: STYX
GUN: 3822 OPT: VD
DIST: 100 AMMO: FED
WSPD: _____ DIR: _____
TMP: _____ BAR: _____
OTHR: LOW INSULIN

THE NATIONAL TARGET CO.
3958-D DARTMOUTH CT. • FREDERICK, MD 21703
MAKERS AND DISTRIBUTORS OF OFFICIAL NRA TARGETS
N.R.A. LICENSE NO. 1


B-16
(1993)

100 yards with heat index >100
Gusts to 10 MPH
Unaware of very low blood glucose @65
Left range and ate two donuts with electrolyte

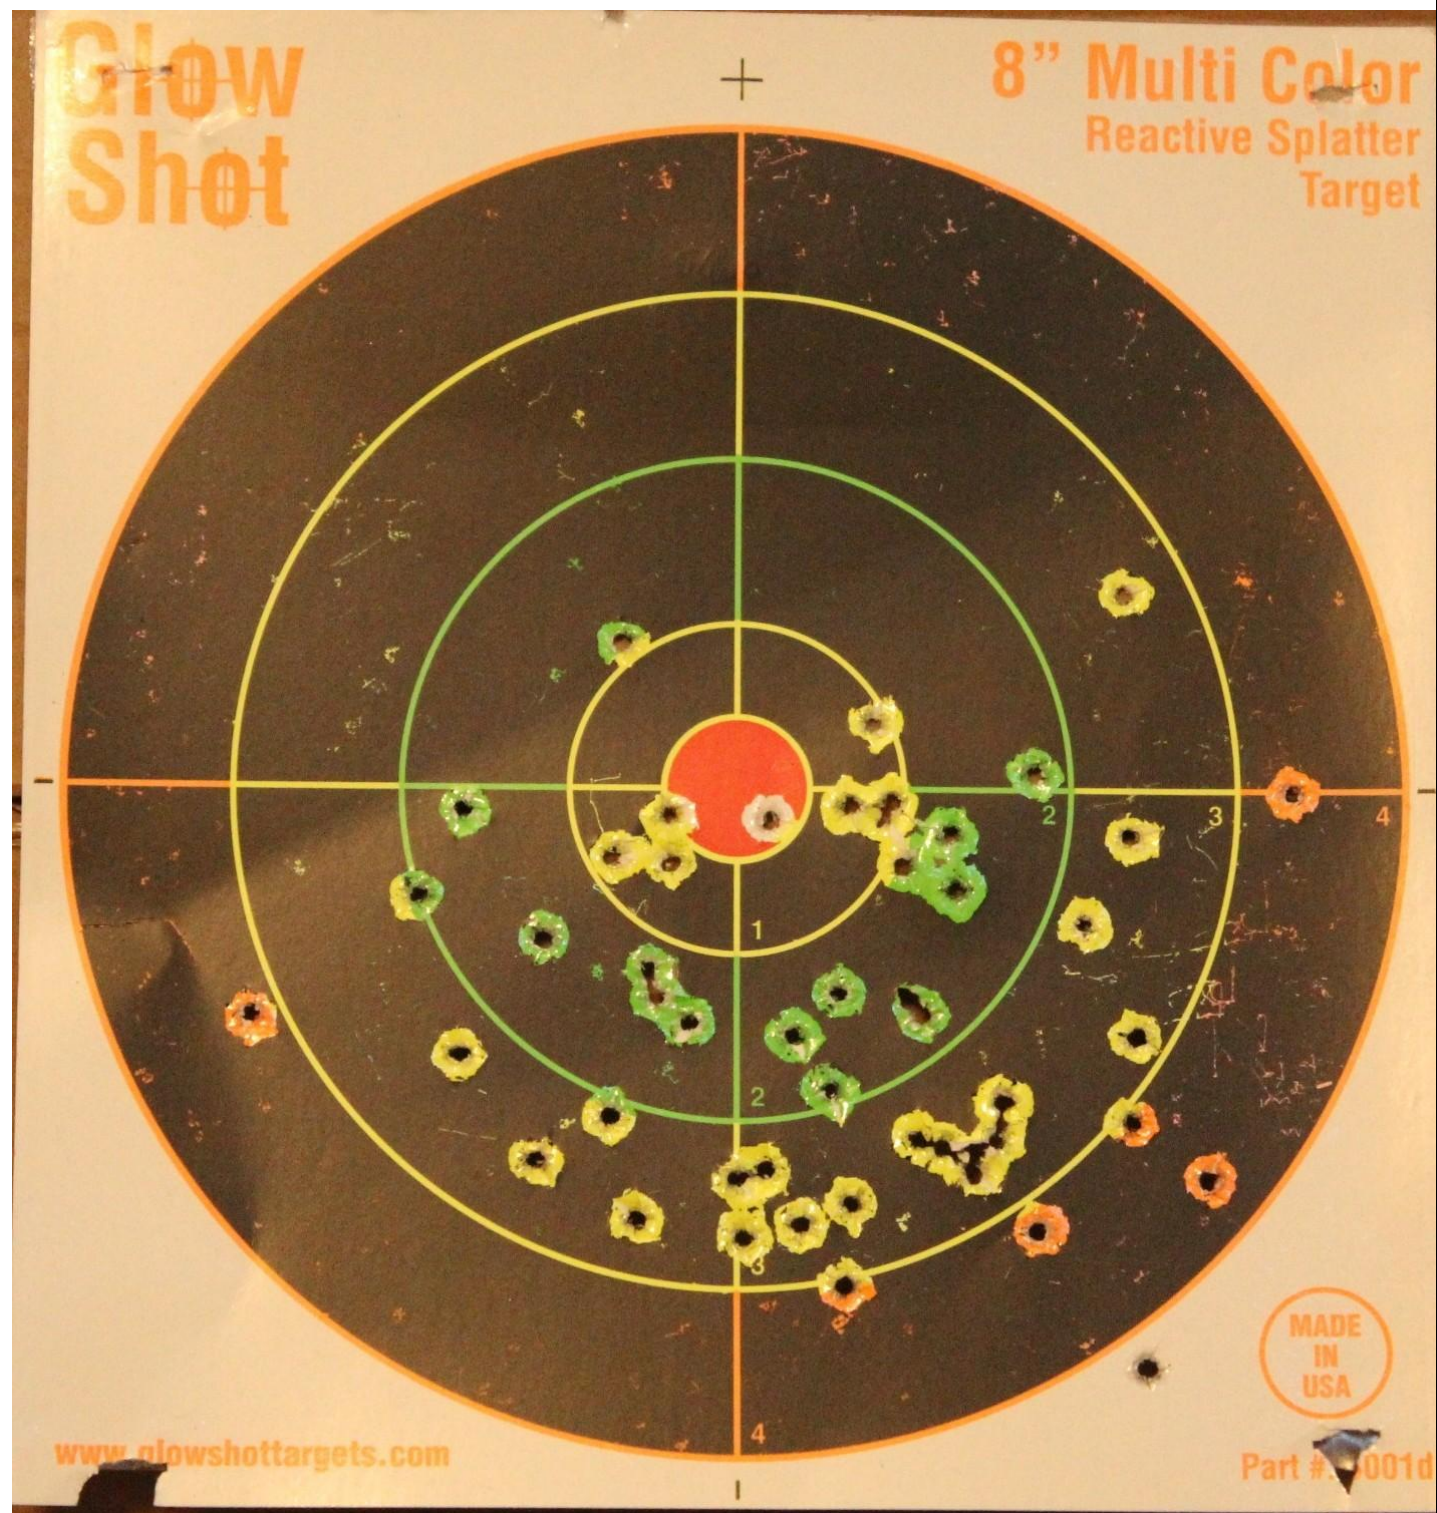

100 yards, "rapid fire" with mag changes, holding center
Wind was 4-6 MPH, gusts to 12 MPH.
Swirling at target, through 270° (right, forward, left)
Still had issues with minor trembling from dehydration and blood glucose.

Returned to sight in target (center) after this target.

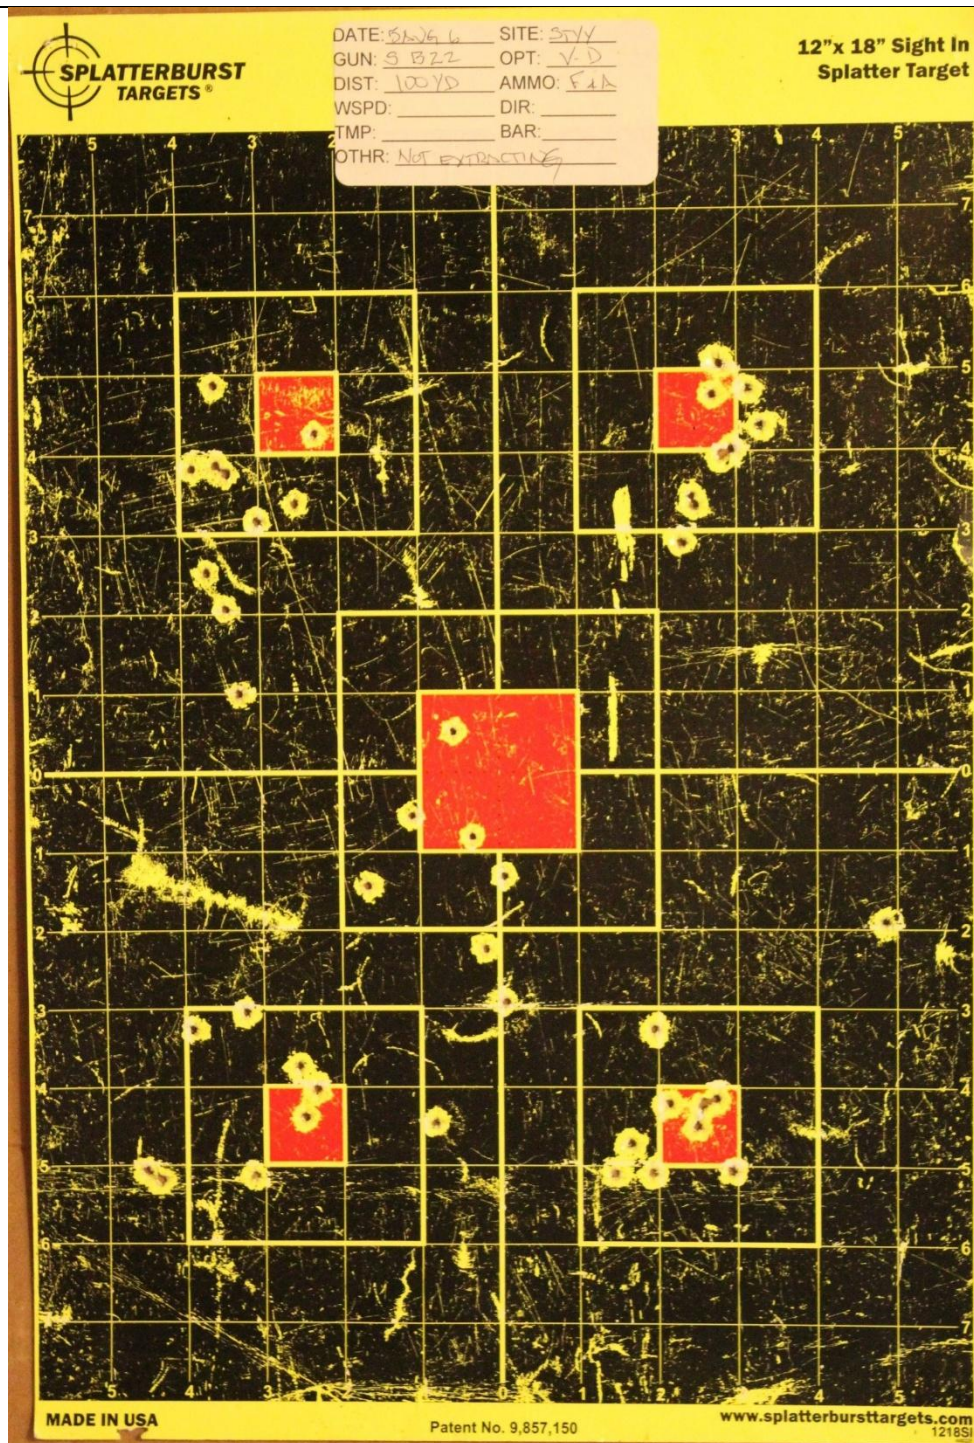

100 yards, slightly dehydrated
Prominent mirages interfering with sighting
Severe extraction issues
Wind very swirly and inconsistent



100 yards, slow and deliberate fire
Wind issues continue; waited for L-R, though varying speed
Took hydration break
Heat index >105